



M Square Energy Pty. Ltd.

Add: 96-100 Toongabbie Road Girraween NSW 2145

Website: [www.msquareenergy.com.au](http://www.msquareenergy.com.au)

No: 1800 336 786

# **Installation Guide For M Square Energy Photovoltaic Panel**



# TABLE OF CONTENT:

- 1.0 Purpose of this guide**..... NO. 3
  - General safety..... NO. 3
  - Handling safety.....NO. 4
  - Installation safety.....NO. 5
  - Fire safety.....NO.6
- 2.0 Product Identification**.....NO. 6
- 3.0 Mechanical Installation**..... NO.7
  - Selecting the location..... NO. 7
  - General Installation..... NO. 8
  - Installation methods..... NO. 8
  - Attachment guidelines..... NO. 9
- 4.0 Electrical Installation**..... NO. 13
  - General installation..... NO. 13
  - Grounding..... NO. 15
  - Series and Parallel Connections ..... NO. 16
- 5.0 Maintenance** ..... NO. 17
- 6.0 Dimensions &Parameters**.....NO. 18



M Square Energy Pty. Ltd.  
Add: 96-100 Toongabbie Road Girraween NSW 2145  
Website: [www.msquareenergy.com.au](http://www.msquareenergy.com.au)  
No: 1800 336 786

## Purpose of this guide

- This guide contains information regarding the installation and safe handling of M SQUARE ENERGY solar system Pty. Ltd., photovoltaic module (hereafter referred to as "module"). M SQUARE ENERGY solar system Pty. Ltd. referred to as "M SQUARE ENERGY".
- Installers must read and understand this guide prior to installation. For any questions, please contact our Global Quality & Customer Support department for further information. Installers should follow all safety precautions described in this guide as well as local codes when installing a module.
- Before installing a solar photovoltaic system, installers should familiarize themselves with its mechanical and electrical requirements. Keep this guide in a safe place for future reference (care and maintenance) and in case of sale or disposal of the modules.

## General safety

- Modules that fall under this application class may be used in system operating at more than 50V DC or 240W, where general contact access is anticipated. The module is considered to be in compliance with IEC61215&61730 only when the modules mounted in the manner specified by the mounting instructions below.
- A module with exposed conductive parts is considered in compliance with IEC61215&61730 only when it is electrically grounded in accordance with the instructions presented below and the requirements of the National Electrical Code.
- Installing solar photovoltaic systems requires specialized skills and knowledge. Installation should only be performed by qualified persons.
- Installers should assume all risks of injury that might occur during installation, including, but not limited to, the risk of electric shock.
- One single module may generate more than 30V DC when exposed to direct sunlight. Contact with a DC voltage of 30V or more is potentially hazardous.
- Do not disconnect under load.
- Photovoltaic solar modules convert light energy to direct current electrical energy. They are designed



for outdoor use. Modules can be ground mounted, mounted on rooftops, vehicles or boats. The proper design of support structures lies within responsibility of the system designers and installers.

- Do not use mirrors or other magnifiers to concentrate sunlight onto the modules.
- When installing the system, abide to all local, regional and national statutory regulations. Obtain a building permit if necessary.
- This product must be installed by a licensed electrician in accordance with the applicable electrical code (i.e. the NEC for the USA and CEC for Canada).
- The electrical characteristics are under standard test conditions (irradiance of 100 mW/cm<sup>2</sup>, AM 1.5 spectrum, and a cell temperature of 25°C (77°F)).
- Only use equipment, connectors, wiring and support frames suitable for solar electric systems.

#### **Handling safety**

- Do not lift the module by grasping the module's junction box or electrical leads.
- Do not stand or step on the module.
- Do not drop the module or allow objects to fall on the module.
- To avoid glass breakage, do not place any heavy objects on the module.
- Be cautious when setting the module down on to a surface.
- Inappropriate transport and installation may break the module.
- Do not attempt to disassemble the modules, and do not remove any attached nameplates or components from the modules.
- Do not apply paint or adhesive to the module top surface.
- To avoid damage to the back sheet, do not scratch or hit the back sheet.
- Do not drill holes in the frame. This may compromise the frame strength and cause corrosion of the frame.
- Do not scratch the anodized coating of the frame (except for grounding connection). It may cause corrosion of the frame or compromise the frame strength.
- Be careful when setting the panel down onto a surface, particularly when placing it on a corner.
- A panel with broken glass or torn back sheet cannot be repaired and must not be used since contact with any panel surface or the frame can cause an electric shock.
- Work only under dry conditions and use only dry tools. Do not handle panels when they are wet unless wearing appropriate protective equipment.



M Square Energy Pty. Ltd.  
Add: 96-100 Toongabbie Road Girraween NSW 2145  
Website: [www.msquareenergy.com.au](http://www.msquareenergy.com.au)  
No: 1800 336 786

- When storing uninstalled panels outdoors for any period of time, always cover the panels and ensure that the glass faces down to stop water from collecting inside the panel and causing damage to exposed connectors.

#### **Installation safety**

- Any module without a frame (laminate) shall not be considered to comply with the requirements of IEC61215&61730 unless the module is mounted with hardware that has been tested and evaluated with the module under this standard or by a field Inspection certifying that the installed module complies with the requirements of IEC61215&61730.
- Never open electrical connections or unplug connectors while the circuit is under load. And do not disconnect during load connection for a removable connector.
- Contact with electrically charged parts of the panels, such as terminals, can result in burns, sparks and lethal shock whether the panel is connected.
- Do not touch the PV module unnecessarily during installation. The glass surface and the frame may be hot; there is a risk of burns and electric shock.
- Do not work in the rain, snow or in windy conditions.
- Avoid exposing cables to direct sunlight in order to prevent their degradation.
- Keep children well away from the system while transporting and installing mechanical and electrical components.
- Do not expose the artificially sunlight to a module or panel. And completely cover the module with an opaque material during installation to prevent electricity from being generated.
- Do not wear metallic rings, watchbands, ear, nose, lip rings or other metallic objects while installing or troubleshooting photovoltaic systems.
- Use only insulated tools that are approved for working on electrical installations.
- Follow the safety regulations for all other system components, including wires and cables, connectors, charging regulators, inverters, storage batteries, rechargeable batteries, etc.
- Under normal outdoor conditions the current and voltage generated by the system will differ from those listed on the datasheet. Datasheet values are the values measured under standard test conditions. Accordingly, during system designing phase, current and short-circuit current should be multiplied by a factor of 1.25 to determine components ratings.
- Only use connectors to connect modules to form a string or connect to another device. Removing the



M Square Energy Pty. Ltd.  
Add: 96-100 Toongabbie Road Girraween NSW 2145  
Website: [www.msquareenergy.com.au](http://www.msquareenergy.com.au)  
No: 1800 336 786

connectors will make the warranty void.

### Fire Safety

- The fire rating of this module is valid only when mounted in the manner specified in the mechanical mounting instructions.
- The fire rating of the module can be referred to UL790.
- Consult your local authority for guidelines and requirements for building or structural firesafety.
- Roof constructions and installations may affect the fire safety of a building; Improper installation may create hazards in the event of a fire.
- Use components such as ground fault circuit breakers and fuses as required by local authority.
- Do not use panels near equipment or in places where flammable gases may be generated.
- Do not use non-integral module and panel are installed on a roof that has fire danger. If a non-integral module and panel are installed on a roof that must have fire-resistant degree of class A.
- The safe distance between the module and the roof we suggest is 20~30 centimeters.

### Product Identification

Each module has two labels providing the following information:

1. **Nameplate:** describes the product type; rated power, rated current, rated voltage, open circuit voltage, short circuit current, all as measured under standard test conditions; weight, dimensions etc.; the maximum system voltage of 1500 volts DC.
2. **Barcode:** each individual module has a unique serial number. The serial number has 18 digits. The first is type, the second is poly or mono silicon, the third is factory, the fourth is cell size, the fifth and sixth is pcs of cells, the seventh to tenth is year and month, the eleventh and thirteenth is batch number, the fourteenth to eighteenth is number. Each module has only one barcode. It is permanently attached to the interior of the module and is visible from the front of the module. This bar code is inserted prior to laminating.

### Rule for Serial number for MSE series



*Do not remove any labels. Removing a label will make the M square Energy warranty void.*



## **Mechanical Installation**

### **Selecting the location**

- Select a suitable location for installing the modules.
- The suitable altitude for installing is below 2000 meters.
- The modules should be facing south in northern latitudes and north in southern latitudes.
- For detailed information on the best installation angle, refer to standard solar photovoltaic installation guides or consult a reputable solar installer or systems integrator.
- The module should not be shaded at any time.
- Do not use modules near equipment or in locations where flammable gases may be generated or collected.

### **General Installation**

- The module mounting structure must be made of durable, corrosion-resistant and UV-resistant material.
- In regions with heavy snowfall in winter, select the height of the mounting system so that the lowest edge of the module is not covered by snow for any length of time.
- In addition, ensure that the lowest portion of the module is placed high enough so that it is not shaded by plants or trees or damaged by flying sand.
- Modules must be securely attached to the mounting structure.
- Provide adequate ventilation under the modules in conformity to your local regulations. A minimum distance of 10 cm between the roof plane and the frame of the module is generally recommended.
- Always observe the instructions and safety precautions included with the module support frames.
- Do not attempt to drill holes in the glass surface of the modules as this will void the warranty.
- Do not drill additional mounting holes in the module frames of the modules as this will void the warranty.
- Before installing modules on a roof, ensure that the roof construction is suitable. In addition, any roof penetration required to mount the module must be properly sealed to prevent leaks.
- When installing a module on a pole, choose a pole and module mounting structure that will withstand the anticipated winds for the area.
- Dust building up on the surface of the module can impair with module performance. M SQUARE ENERGY

recommend installing the modules with a tilt angle of at least 10 degrees, making it easier for dust to be washed off by rain.

- Observe the linear thermal expansion of the module frames (the recommended minimum distance between two modules is 2 cm).
- Always keep the back sheet of the panel free from foreign objects or structural elements, which could come into contact with the panel, especially when the panel is under mechanical load.
- Ensure panels are not subjected to wind or snow loads exceeding the maximum permissible loads and are not subject to excessive forces due to the thermal expansion of the support structures: See the following paragraph for more detailed information.

#### **Installation methods**

- Common hardware items such as nuts, bolts, star washers, lock washers and the like have not been evaluated for electrical conductivity or for use as grounding devices and should be used only for maintaining mechanical connections and holding electrical grounding devices in the proper position for electrical conductivity. Such devices, where supplied with the module and evaluated through the requirements in UL 1703, may be used for grounding connections in accordance with the instructions provided with the module.
- We suggest each module be securely fastened at 8 points (14mm×9mm). Modules must be installed according to the following examples. Not mounting the modules according to these instructions may void the warranty.
- For our modules, designed mechanical load of front face is 3600Pa and safety factor is 1.5; designed mechanical load of back face is 1600Pa and safety factor is 1.5.
- Module can be installed in both landscape and portrait modes.
- For best performance, separate laying of positive and negative cables wherever possible. Induced voltage surges in the DC main cable should be minimized by laying the positive and negative cables as close together as possible.
- Where this is not possible or not desirable, the inverter energy system should be connected
- to the distribution board located physically nearest to the inverter, and the main switchboard. And main switch for the switchboard, to which the inverter is connected, shall be a lockable switch.
- The modules must be properly secured to their support so that they can withstand live load conditions,



including wind uplift, to the pressure they have been certified for. It is the installer's responsibility to ensure that the clamps used to secure the modules are strong enough.

Attachment guidelines

■ Screw Installation

Each PV module has 8 mounting holes (shown as drawing 1).The downward mechanical load resistance of module would be different according to the installation holes used(shown as table 1),Please use 8 of them to secure the modules to support structure. The module frame must be attached to a mounting rail using M8 corrosion-proof screws together with spring washers and flat washers in eight symmetrical locations on the PV module. The applied torque should be big enough to fix it steadily.The reference torque value for M8 screw is 16~20N\*m.


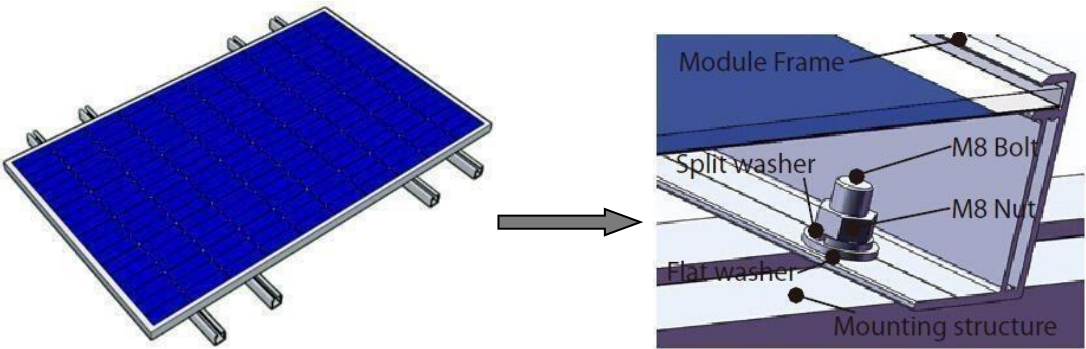
	5400Pa Load Tested
Mounting system	

Table 1



Drawing 1

## ■ Clamp Installation

The modules can be fixed on both the long and the short side of the module within the constraints shown in drawing 2, using a minimum of four clamps. The modules are built to withstand a downward force of up to 5400 Pa (550 kg/m<sup>2</sup>) or 2400 Pa (244 kg/m<sup>2</sup>) according to where they are clamped. Site-specific loads such as wind or snow which may exert forces in a different way need to be taken into consideration to ensure this limit is not exceeded for each respective mounting option.

### A. For standard module with back sheet

#### 1. Clamp picture as below:



Figure 1 Double-side clamp



Figure 2 Single-side clamp

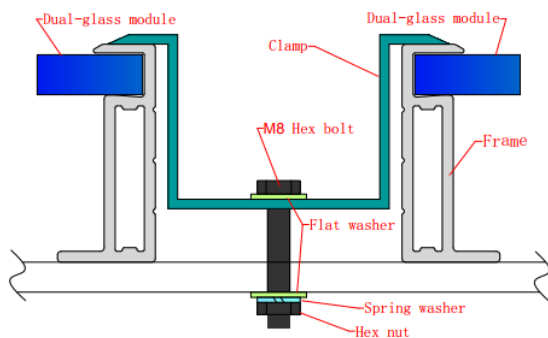


Figure 3 Double-side clamp installation


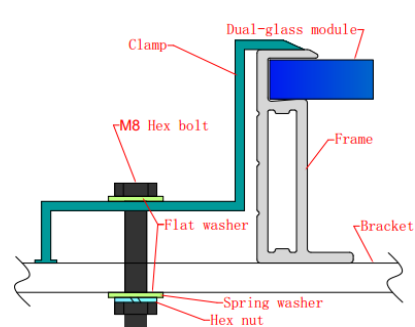


Figure 4 Single-side clamp installation

## 2. Install module with clamps at long sides of frames

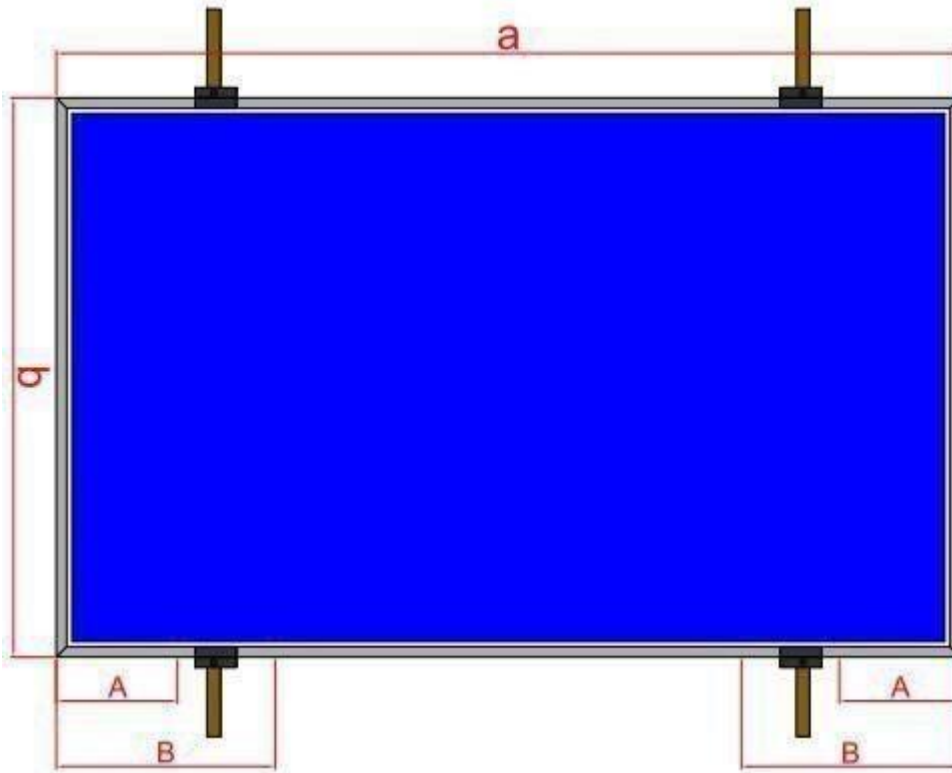

Drawing 3

The selection and installation of the clamps shall obey the requirement according to table 3 (mounting area is between A and B). Otherwise the module may not satisfy the mechanical load and have the risk of broken.

This Installation method is applicable to the series of PV modules as listed below:

Table 2

Type -1	MSEA60-290W	Type -6	MSEA72M9-430W
	MSEA60-295W		MSEA72M9-435W
	MSEA60-300W		MSEA72M9-440W
	MSEA60-305W		MSEA72M9-445W
	MSEA60-310W		MSEA72M9-450W
Type-2	MSEA72-350W	Type-7	MSEA72M9-455W
	MSEA72-355W		MSEA72M9-460W
	MSEA72-360W		MSEA60M9-360W
	MSEA72-365W		MSEA60M9-365W
	MSEA72-370W		MSEA60M9-370W
Type-3	MSEA-385W-MH72	Type-8	MSEA60M9-375W
	MSEA-390W-MH72		MSEA60M9-380W
	MSEA-395W-MH72		MSEA60M9-385W
	MSEA-400W-MH72		MSEA60M9-390W
	MSEA-405W-MH72		MSEA72M10-520W
	MSEA-410W-MH72		MSEA72M10-525W
	MSEA-415W-MH72		MSEA72M10-530W
	MSEA-420W-MH72		MSEA72M10-535W
Type-4	MSEA-320W-MH60	Type-9	MSEA72M10-540W
	MSEA-325W-MH60		MSEA72M10-545W
	MSEA-330W-MH60		MSEA72M10-550W
	MSEA-335W-MH60		MSEA66M10-475W
	MSEA-340W-MH60		MSEA66M10-480W
	MSEA-345W-MH60		MSEA66M10-485W
	MSEA-350W-MH60		MSEA66M10-490W
Type-5	MSEA-415W-MH78	Type-10	MSEA66M10-495W
	MSEA-420W-MH78		MSEA66M10-500W
	MSEA-425W-MH78		MSEA66M10-505W
	MSEA-430W-MH78		MSEA60M10-430W
	MSEA-435W-MH78		MSEA60M10-435W
	MSEA-440W-MH78		MSEA60M10-440W
	MSEA-445W-MH78		MSEA60M10-445W
	MSEA-450W-MH78		MSEA60M10-450W
	MSEA-455W-MH78		MSEA60M10-455W
			MSEA60M10-460W

Module type	a (mm)	b (mm)	Clamp length	A (mm)	B (mm)	Loads (Pa)
Type 1	1650	991	≥50 mm	180	480	3600
				0	480	1600
Type 2	1956	991	≥50 mm	280	580	1600
				0	580	1600
Type 3	2000	1002	≥50 mm	280	480	3600
				0	480	1600
Type 4	1686	1002	≥50 mm	180	580	3600
				0	580	1600
Type 5	2172	1102	≥50 mm	280	480	3600
				0	480	1600

Module type	a (mm)	b (mm)	Clamp length	A (mm)	B (mm)	Loads(Pa)
Type 6	2094/ 1970/1956	1048/1002	≥50 mm	280	580	3600
				0	580	1600
Type 7	1755/ 1970/1956	1038/1002	≥50 mm	180	480	3600
				0	480	1600
Type 8	2279/ 1970/1956	1134/1002	≥50 mm	280	580	3600
				0	580	1600
Type 9	2094/ 1970/1956	1134/1002	≥50 mm	180	480	3600
				0	480	1600
Type 10	1910/ 1970/1956	1134/1002	≥50 mm	180	480	3600
				0	480	1600

Table 3



**WARNING Electrical Hazard**

This module produces electricity when exposed to light. Follow all applicable electrical safety precautions.

**ONLY** qualified personnel can install or perform maintenance work on these modules. **BE AWARE** of dangerous high DC voltage when connecting module. **DO NOT** damage or scratch the rear surface of the module. **DO NOT** handle or install module when they are wet.

## Electrical Installation

### General installation

- Any hardware used must be compatible with the mounting structure material to avoid galvanic corrosion
- It is not recommended to use modules with different configurations (grounding, wiring) in the same system.
- The module maximum system voltage is 1500 volts DC(For –HV module) and 1000 volts DC(For other module). For applications requiring a high operating voltage several modules can be connected in series




M Square Energy Pty. Ltd.  
Add: 96-100 Toongabbie Road Girraween NSW 2145  
Website: [www.msquareenergy.com.au](http://www.msquareenergy.com.au)  
No: 1800 336 786

to form a string of modules; The system voltage is then equal to the sum of the voltage of each module.

- For applications requiring high operating currents several strings of modules can be connected in parallel; the system current is then equal to the sum of the current of each string of modules.
- Our modules are supplied with connectors to be used for system electrical connections.
- The maximum number of series connected modules can be calculated through this formula:  $1500 / (1.25 \times V_{oc})$ .
- The recommended maximum parallel module configuration is 16 parallels. And the number of modules have something to do with system design parameters such as current or power output.
- Please refer to local regulations to determine the system wires size, type and temperature.
- To prevent the cables and the connectors from overheating, the cross section of the cables and the capacity of the connectors must be selected to suit the maximum system short circuit current (The recommended cable cross section is  $4\text{mm}^2$  for a single module and if rated current of a connector is higher than 10A). Please note that the upper limit temperature of cable is  $85^\circ\text{C}$ , and that of the connector is  $105^\circ\text{C}$ . And all the cables diameter that been used for wiring must reach at least  $4\text{mm}^2$ .
- The DC current generated by photovoltaic systems can be converted into AC and fed into a public grid. As local utilities' policies on connecting renewable energy systems to their grids vary from region to region. A qualified system designer or integrator should always be consulted. Building permits, inspections and approvals by the local utility are generally required.


## Grounding

- Where common grounding hardware (nuts, bolts, star washers, split-ring lock washers, flat washers and the like) is used to attach a listed grounding/bonding device, the attachment must be made in conformance with the grounding device manufacturer's instructions."
- For grounding and bonding requirements, please refer to regional and national safety and electricity standards. If grounding is required, use a recommended connector type, or an equivalent, for the grounding wire.
- If grounding is required, the grounding wire must be properly fastened to the module frame to assure adequate electrical connection.

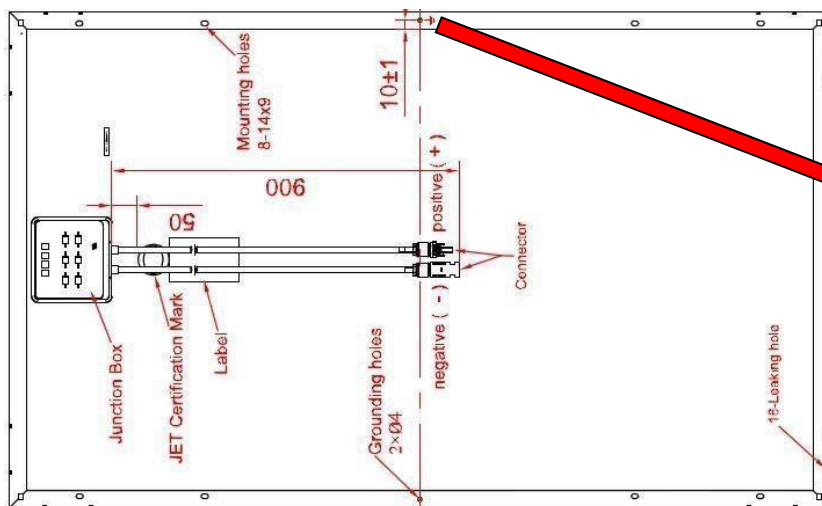

For double glass module

## Series and Parallel Connections

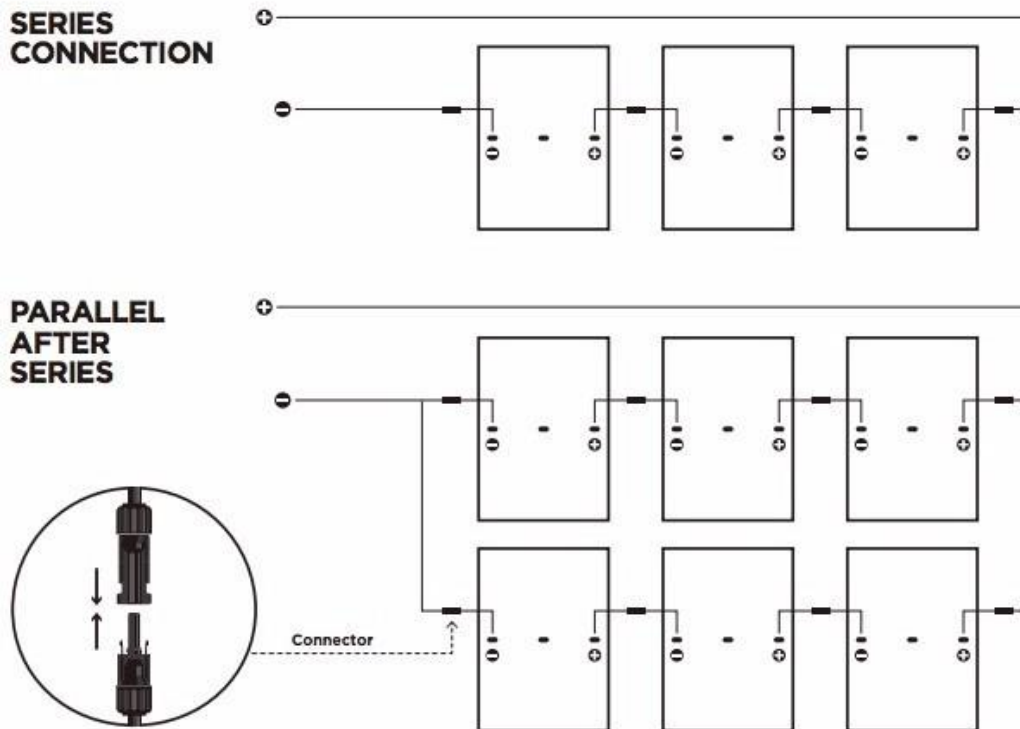

- \* Electrical performance parameter of module, such as nominal value of  $I_{sc}$ ,  $V_{oc}$  and  $P_{max}$  has  $\pm 3\%$  random error compared with value of STC. The standard testing environment of module is: Irradiance  $1000/m^2$ , Cell temperature  $25^{\circ}C$ , Spectrum AM 1.5.
- \* Normally, the current and voltage of module, will be a little higher compared with the value under STC, so when confirmed the associated parameters of solar system accessories, such as rated voltage, cable capacity, fuse capacity and module power, the corresponding short circuit current and open circuit voltage should be amplified by 1.25 times.
- \* The maximum number of modules per series string must be calculated according to the requirements. The value of the  $V_{oc}$  in the local expected minimum temperature cannot exceed the maximum system voltage value specified of the module (According to IEC61730 safety test, the maximum system voltage of Msquare Energy Module is DC1000V) and other DC electrical components require values.
- \* The  $V_{oc}$  correction factor can be calculated according to the following formula:  $C_{Voc} = 1 - \beta \times (25 - T)$ ,  $T$  is the minimum ambient temperature expected for the installation of the system,  $\beta$  ( $\% / ^{\circ}C$ ) is The temperature coefficient of the selected module  $V_{oc}$  (according to the corresponding module data sheet).
- \* If the reverse current which probably exceed the maximum fuses current of module passed through the module, the modules must be protected by an equivalent current protection device. If the number of parallel is more than or equal to 2 strings, there must be equipped an overcurrent protection device on each series of modules.





M Square Energy Pty. Ltd.  
Add: 96-100 Toongabbie Road Girraween NSW 2145  
Website: [www.msquareenergy.com.au](http://www.msquareenergy.com.au)  
No: 1800 336 786

## Maintenance

- To ensure optimum module performance, M SQUARE ENERGY recommends the following maintenance measures:
- Clean the glass surface of the module when required. Always use clean water and a soft sponge or cloth for cleaning. A mild, non-abrasive cleaning agent may be used to remove stubborn dirt.
- Check the electrical, grounding and mechanical connections every six months to verify that they are clean, secure, undamaged and free of corrosion.
- If any problem arises, consult a professional for suggestions.
- Caution: observe the maintenance instructions for all components used in the system, such as support frames, charging regulators, inverters, batteries etc.

## Dimension & Parameters: -

Module family A:	With Mono c-Si cell type	
Type Name or Model No. ....	MSEA72-xxxW	MSEA60-xxxW
Maximum System Voltage [VDC]	1500	1500
Rated Maximum Power [W] .....	325, 330, 335, 340, 345, 350, 355, 360, 365, 370	275, 280, 285, 290, 295, 300, 305, 310
Rated Short Circuit Current [A] .....	9.19, 9.26, 9.36, 9.45, 9.50, 9.60, 9.69, 9.76, 9.82, 9.91	9..25, 9.35, 9.44, 9.50, 9.55, 9.64, 9.72, 9.81
Rated Open Circuit Voltage [V] .....	45.9, 46.1, 46.3, 46.5, 46.7, 46.9, 47.0, 47.2, 47.4, 47.6	38.8, 39.0, 39.2, 39.5, 39.7, 39.9, 40.2, 40.4
Tolerance of Rating Pmax/Isc/Voc [%] .....	3/4/4	3/4/4
Over-current protection rating[A]:	16	16
Classification (IEC 61730) .....	Class II	Class II
Fire rating .....	Class C	Class C
Dimensions (l x w x h) [mm] .....	1956 x 991 x 40	1650 x 991 x 35
Module area [m <sup>2</sup> ] .....	1.94	1.64
Min- creepage distance [mm] .....	14.75	14.75
Number of solar cells	72	60
Cells per bypass diode	24	20
Serial/parallel connection of cells	S	S
Type Name or Model No. ....	MSEA-xxxW-MH72	MSEA-xxxW-MH60
Maximum System Voltage [VDC]	1500	1500
Rated Maximum Power [W] .....	385, 390, 395, 400, 405, 410, 415, 420	320, 325, 330, 335, 340, 345, 350
Rated Short Circuit Current [A] .....	10.21, 10.24, 10.27, 10.32, 10.35, 10.40, 10.43, 10.47	10.20, 10.27, 10.33, 10.39, 10.46, 10.53, 10.59
Rated Open Circuit Voltage [V] .....	48.4, 48.6, 48.8, 49.0, 49.2, 49.4, 49.6, 49.8	40.2, 40.4, 40.6, 40.8, 41.0, 41.5, 41.4
Tolerance of Rating Pmax/Isc/Voc [%] .....	3/3/3	3/3/3
Over-current protection rating[A]:	20	20
Classification (IEC 61730) .....	Class II	Class II
Fire rating .....	Class C	Class C
Dimensions (l x w x h) [mm] .....	2000 x 1002 x 40	1686 x 1002 x 35
Module area [m <sup>2</sup> ] .....	2.0	1.69
Min- creepage distance [mm] .....	14.88	14.88
Number of solar cells	144	120
Cells per bypass diode	48	40
Serial/parallel connection of cells	SP	SP



M Square Energy Pty. Ltd.  
 Add: 96-100 Toongabbie Road Girraween NSW 2145  
 Website: [www.msquareenergy.com.au](http://www.msquareenergy.com.au)  
 No: 1800 336 786

Type Name or Model No. ....	MSEA-xxxW-MH78	
Maximum System Voltage [VDC]	1500	
Rated Maximum Power [W] .....	415, 420, 425, 430, 435, 440, 445, 450, 455	
Rated Short Circuit Current [A] .....	10.06, 10.12, 10.18, 10.24, 10.30, 10.37, 10.42, 10.47, 10.54	
Rated Open Circuit Voltage [V] .....	52.1, 52.3, 52.5, 52.7, 52.9, 53.1, 53.3, 53.5, 53.7	
Tolerance of Rating Pmax/Isc/Voc [%] .....	3/3/3	
Over-current protection rating[A]:	20	
Classification (IEC 61730) .....	Class II	
Fire rating .....	Class C	
Dimensions (l x w x h) [mm] .....	2172x1002x40	
Module area [m <sup>2</sup> ] .....	2.18	
Min- creepage distance [mm] .....	14.88	
Number of solar cells	156	
Cells per bypass diode	52	
Serial/parallel connection of cells	SP	
Type Name or Model No. ....	MSEA72M9-xxxW	MSEA60M9-xxxW
Maximum System Voltage [VDC]	1500	1500
Rated Maximum Power [W] .....	430, 435, 440, 445, 450, 455, 460, 465	360, 365, 370, 375, 380, 385
Rated Short Circuit Current [A] .....	11.23, 11.26, 11.29, 11.32, 11.35, 11.38, 11.41, 11.44	11.24, 11.30, 11.36, 11.42, 11.48, 11.54
Rated Open Circuit Voltage [V] .....	48.70, 48.85, 49.00, 49.15, 49.30, 49.45, 49.60, 49.75	40.6, 40.8, 41.0, 41.2, 41.4, 41.6
Tolerance of Rating Pmax/Isc/Voc [%] .....	3/3/3	3/3/3
Over-current protection rating[A]:	20	20
Classification (IEC 61730) .....	Class II	Class II
Fire rating .....	Class C	Class C
Dimensions (l x w x h) [mm] .....	2108x1048x35/40 2094x1038x35/40	1765x1048x35 1755x1038x35
Module area [m <sup>2</sup> ] .....	2.21 / 2.17	1.85 / 1.82
Min- creepage distance [mm] .....	13.75	13.8
Number of solar cells	144	120
Cells per bypass diode	48	40
Serial/parallel connection of cells	SP	SP
Design load down / up [Pa] .....	3600/1600	3600/1600
Safety factors	1.5	1.5

Type Name or Model No. ....	MSEA72M10-xxxW	MSEA66M10-xxxW
Maximum System Voltage [VDC]	1500	1500
Rated Maximum Power [W] .....	525, 530, 535, 540, 545, 550, 555	485, 490, 495, 500, 505
Rated Short Circuit Current [A] .....	13.48, 13.54, 13.60, 13.66, 13.72, 13.78, 13.84	13.60, 13.66, 13.72, 13.78, 13.84
Rated Open Circuit Voltage [V] .....	49.2, 49.4, 49.6, 49.8, 50.0, 50.2, 50.4	45.2, 45.4, 45.6, 45.8, 46.0
Tolerance of Rating Pmax/Isc/Voc [%] .....	3/3/3	3/3/3
Over-current protection rating[A]:	20	20
Classification (IEC 61730) .....	Class II	Class II
Fire rating .....	Class C	Class C
Dimensions (l x w x h) [mm] .....	2279x1134x35/40 2256x1134x35/40	2094x1134x35/40 2074x1134x35/40
Module area [m <sup>2</sup> ] .....	2.58 / 2.56	2.37 / 2.35
Min- creepage distance [mm] .....	13.75	13.75
Number of solar cells	144	132
Cells per bypass diode	48	44
Serial/parallel connection of cells	SP	SP
Design load down / up [Pa] .....	3600/1600	3600/1600
Safety factors	1.5	1.5
Type Name or Model No. ....	MSEA60M10-xxxW	
Maximum System Voltage [VDC]	1500	
Rated Maximum Power [W] .....	440, 445, 450, 455, 460	
Rated Short Circuit Current [A] .....	13.54, 13.60, 13.66, 13.72, 13.78	
Rated Open Circuit Voltage [V] .....	41.2, 41.4, 41.6, 41.8, 42.0	
Tolerance of Rating Pmax/Isc/Voc [%] .....	3/3/3	
Over-current protection rating[A]:	20	
Classification (IEC 61730) .....	Class II	
Fire rating .....	Class C	
Dimensions (l x w x h) [mm] .....	1910x1134x35/40 1891x1134x35/40	
Module area [m <sup>2</sup> ] .....	2.17 / 2.14	
Min- creepage distance [mm] .....	14.88	
Number of solar cells	120	
Cells per bypass diode	40	
Serial/parallel connection of cells	SP	
Design load down / up [Pa] .....	3600/1600	
Safety factors	1.5	